

REGULAR / A-FRAME 24'-0" WIDE CARPORT STYLE BUILDINGS

DESIGN NOTES

1. ALL CONSTRUCTION SHALL BE PROVIDED IN ACCORDANCE WITH IBC 2009, OSHA, AISC 360, ASCE 7-05, AWS D 1.1 CODES AND ALL APPLICABLE LOCAL REQUIREMENTS.
2. BASE CONNECTIONS SHALL BE PROVIDED AS SHOWN ON FOUNDATION DETAILS SHEET.
3. ALL MATERIALS IDENTIFIED BY MANUFACTURER NAME MAY BE SUBSTITUTED WITH MATERIAL EQUAL OR EXCEEDING ORIGINAL.
4. ALL SHOP CONNECTIONS SHALL BE WELDED CONNECTIONS.
5. ALL FIELD CONNECTIONS SHALL BE #12 (1/4"x1") SDS (ESR-2196 OR EQ).
6. STEEL SHEATHING SHALL BE 29GA. CORRUGATED GALV. OR PAINTED STEEL - MAIN RIB HT. 3/4" (FY=80KSI) OR EQ.
7. ALL STRUCTURAL LIGHT GAUGE TUBING AND CHANNELS SHALL BE GRADE 50 STEEL.
8. STRUCTURAL TUBE TS2 1/2"x2 1/2" - 14GA. IS EQUIVALENT TO TS2 1/4"x2 1/4" - 12GA AND EITHER ONE MAY BE USED IN LIEU OF THE OTHER.
9. ALL DESIGN CRITERIA MUST BE INCREASED TO THE NEXT HIGHER INCREMENT BASED ON THE TABLES ON PAGE 4. NO INTERPOLATION IS ALLOWED.

DESIGN CRITERIA

PREVAILING CODE:	IBC 2009 w/ NH amends 2010
USE GROUP:	U (CARPORTS, BARN)
OCCUPANCY CATEGORY:	I
1. DEAD LOAD (D)	D = 4 PSF
2. ROOF LIVE/SNOW LOAD (Lr)	Lr = 20 - 61 PSF (AS PER SNOW LOAD SEE TABLE 4)
3. SNOW LOAD (S)	
GROUND SNOW LOAD	P _g = 20 - 90 PSF
IMPORTANCE FACTOR	I _s = 0.8
THERMAL FACTOR	C _t = 1.2
EXPOSURE FACTOR	C _e = 1.0
ROOF SLOPE FACTOR	C _s = 1.0
4. WIND LOAD (W)	
BASIC WIND SPEED	V _{ASD} = 90 - 150 MPH
EXPOSURE	C
IMPORTANCE FACTOR	I _w = 0.87 (V _{ASD} <= 100) 0.77 (V _{ASD} > 100)
5. SEISMIC LOAD (E)	
DESIGN CATEGORY	D
IMPORTANCE FACTOR	I _e = 1.00

LOAD COMBINATIONS:

1. D + (Lr OR S)
2. D + (W OR ±0.7E)
3. D + 0.75 (W OR ±0.7E) + 0.75 (Lr OR S)
4. 0.6D + (W OR ±0.7E)

DRAWING INDEX

COVER SHEET	----	1
SCHEDULES & MEMBER - SECTIONS	----	2
FRAME SECTIONS & DETAILS	----	3-A, 3-B
SPACING SCHEDULES - & ENCLOSURE NOTES	----	4
PURLIN & GIRT SCHEDULES	----	5
SHEATHING OPTIONS	----	6
SIDE WALL FRAMING & OPENINGS	----	7-A, 7-B
END WALL FRAMING & OPENINGS	----	8-A, 8-B
CORNER BRACING DETAILS	----	9
OPTIONAL LEAN-TO ADDITION	----	10
FOUNDATION OPTIONS	----	11-A TO 11-D

CUSTOMER INFORMATION

OWNER: _____
ADDRESS: _____

DESIGN LOADS

GROUND SNOW: _____

ROOF LIVE LOAD: _____

BASIC WIND SPEED: _____

BUILDING INFORMATION

WIDTH: _____

LENGTH: _____


HEIGHT: _____

FRAME TYPE: A-FRAME
 REGULAR


ENCLOSURE TYPE: FULL
 PARTIAL
 OPEN

TABLE 2.1: MEMBER PROPERTIES


NO.	LABEL	PROPERTY	DETAIL NO.
1	COLUMN POST	2.5" X 2.5" X 14GA TUBE	1
2	ROOF BEAM	2.5" X 2.5" X 14GA TUBE	1
3	BASE RAIL	2.5" X 2.5" X 14GA TUBE	1
4	PEAK BRACE	2.5" X 2.5" 14GA CHANNEL	4
5	KNEE BRACES	2.5" X 1.5" 14GA CHANNEL	4
6	CONNECTOR SLEEVE	2.25" X 2.25" X 12GA TUBE	2
7	BASE ANGLE	2.5" X 2.5" X 3" LG. 1/4" ANGLE	10
8	PURLIN	4.25" X 1.5" X 18GA / 14GA HAT CHANNEL	5
9	GIRT	4.25" X 1.5" X 18GA / 14GA HAT CHANNEL	5
9A	OPT. END WALL GIRT	2.5" X 1.5" 14GA CHANNEL	1
10	SHEATHING	29 GA CORRUGATED SHEET	8
11	END WALL POST	2.5" X 2.5" X 14GA TUBE	1
12	DOOR POST	2.5" X 2.5" X 14GA TUBE	1
13	SINGLE HEADER	2.5" X 2.5" X 14GA TUBE	1
14	DOUBLE HEADER	DBL. 2.5" X 2.5" X 14GA TUBE	1
15	SERVICE DOOR / WINDOW FRAMING	2.5" X 2.5" X 14GA TUBE	1
16	ANGLE BRACKET	2" X 2" X 2" LG. 14GA ANGLE	7
17	STRAIGHT BRACKET	2" X 2" X 4" LG. 14GA PLATE	6
18	PB SUPPORT	2.5" X 2.5" X 14GA TUBE	1
19	DIAGONAL BRACE	2" X 2" X 14 GA TUBE	3
20	GABLE BRACE	2" X 2" X 14 GA TUBE	3
21	DB BRACKET	2.5" X 2.5" X 6" LG. 14GA ANGLE	9
22	TRUSS SPACER	2.5" X 2.5" X 14GA TUBE	1
23	ALL FASTENERS	#12 X 3/4" SELF-DRILL SCREWS (ESR-2196 OR EQ) W/ NEOPRENE/STEEL WASHER	




THICKNESS = 14GA
2.5" X 2.5" 14GA TUBE
SCALE: NTS (1)




THICKNESS = 12GA
2.25" X 2.25" 12GA TUBE
SCALE: NTS (2)




THICKNESS = 14GA
2" X 2" 14GA TUBE
SCALE: NTS (3)




THICKNESS = 14GA
2.5" X 1.5" 14GA CHANNEL
SCALE: NTS (4)



THICKNESS = 18GA / 14GA
4.25" X 1.5" X 18GA / 14GA
HAT CHANNEL
SCALE: NTS (5)



THICKNESS = 14GA
STRAIGHT BRACKET
SCALE: NTS (6)



THICKNESS = 14GA
ANGLE BRACKET
SCALE: NTS (7)

TABLE 2.2: SHEATHING FASTENER SCHEDULE


LOCATION	CORNER PANELS	SIDE LAPS	EDGE LAPS	ELSEWHERE
SPACING	6" C/C	MIN. 1	4 1/2" C/C	9" C/C

FASTENER TYPE: #12X1" SELF-DRILL SCREWS (ESR-2196 OR EQ) W/ NEOPRENE/STEEL WASHER


*SEE TYP. SHEATHING FASTENER SCHEDULE DIAGRAM ON PAGE 6.

TABLE 2.3: GAUGE THICKNESS


GAUGE	29	18	14	12
THICKNESS (IN)	0.0135	0.049	0.083	0.109

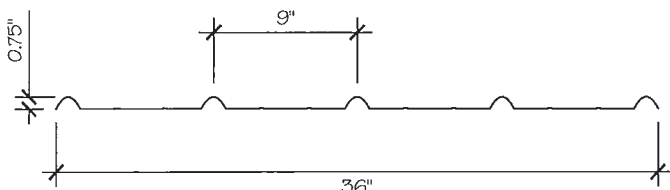


THICKNESS = 29GA
29 GA CORRUGATED SHEATHING
SCALE: NTS (8)




THICKNESS = 14GA
DB BRACKET
SCALE: NTS (9)




THICKNESS = 1/4"
BASE ANGLE
SCALE: NTS (10)

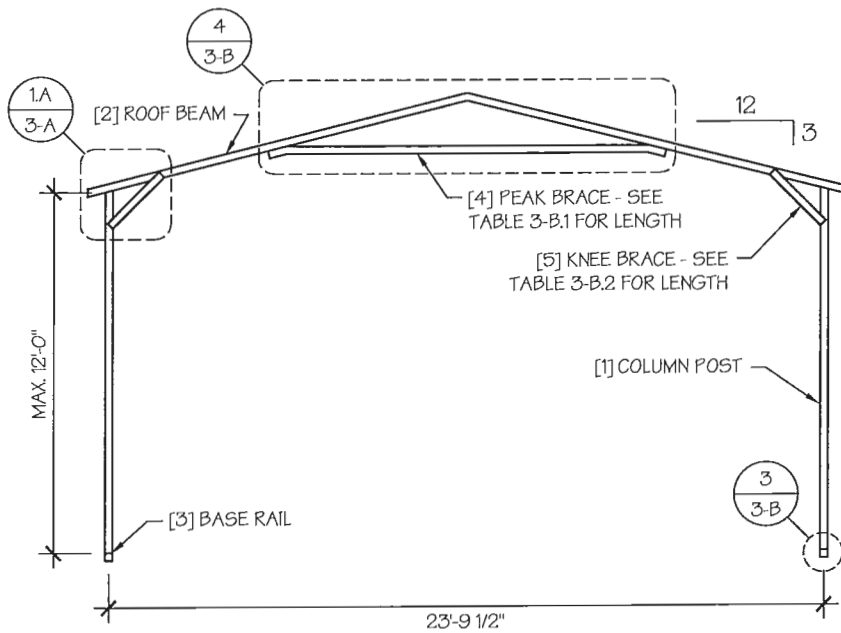


□ TYP. A-FRAME SECTION
SCALE: NTS

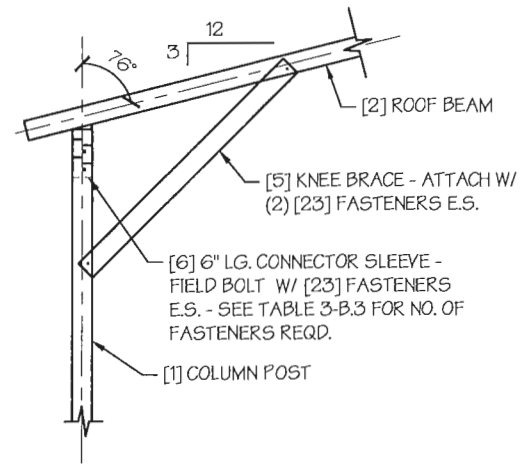


□ A. 'A'-FRAME

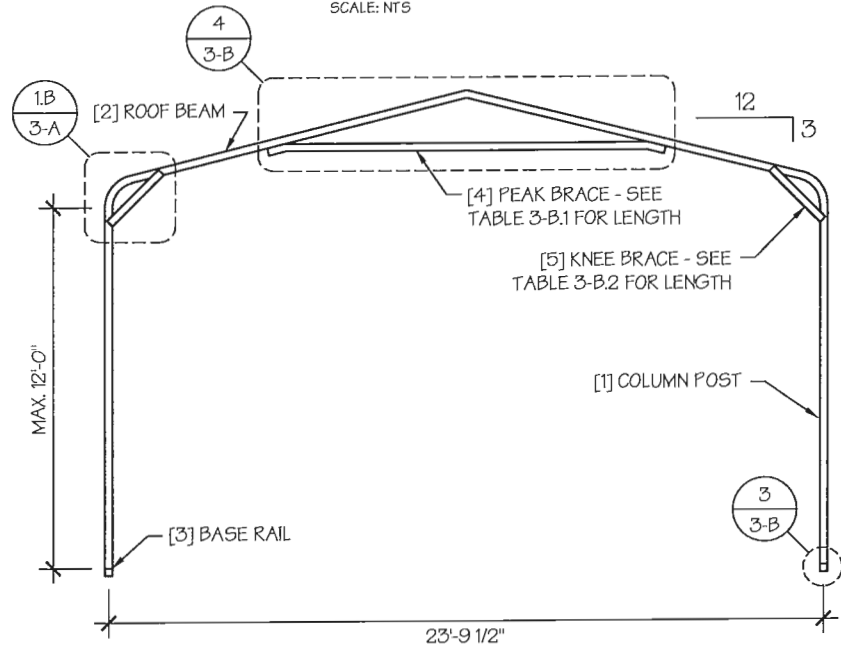


□ TYP. REGULAR FRAME SECTION
SCALE: NTS

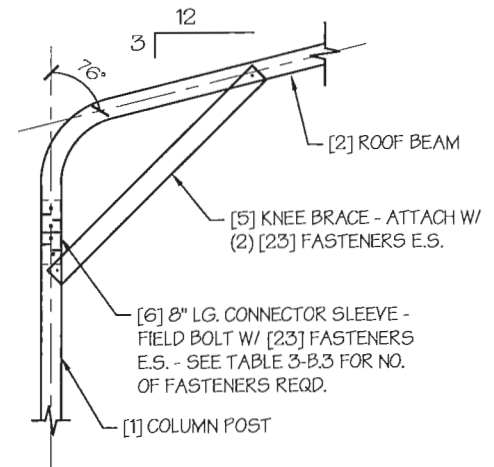


□ B. REGULAR FRAME

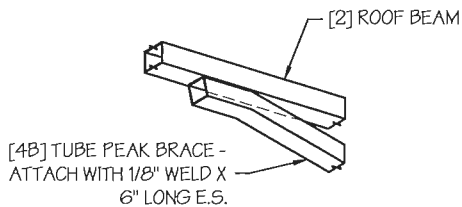


A. PEAK BRACE TUBE

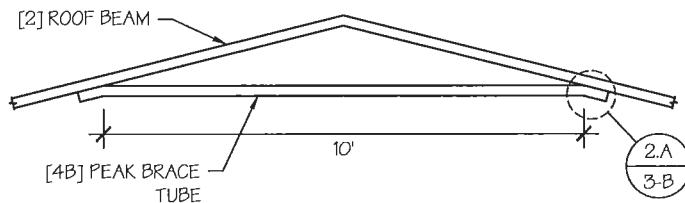

A. WELDED PEAK BRACE

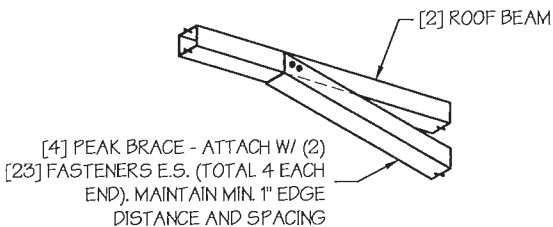

B. PEAK BRACE CHANNEL

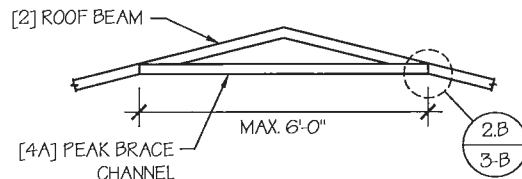

B. CHANNEL PEAK BRACE

PEAK BRACE DETAILS


SCALE: NTS

4

PEAK BRACE CONNECTION DETAILS

SCALE: NTS

2

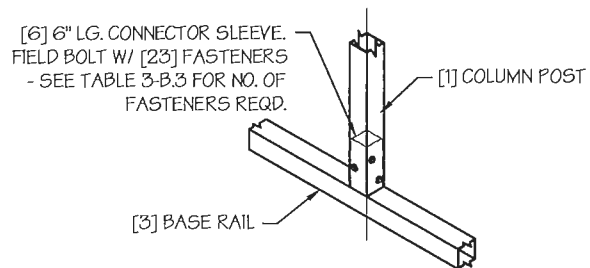

BASE DETAIL

SCALE: NTS

3

TABLE 3-B.1: PEAK BRACE SCHEDULE

GROUND SNOW / ROOF LIVE LOAD (PSF)	WIND SPEED	
	□ 90 TO 110	□ 120 TO 150
□ 30 / 20	6'	10'
□ 35 / 25 TO 90 / 61	10'	10'

TABLE 3-B.2: KNEE BRACE SCHEDULE

EAVE HEIGHT	KNEE BRACE LENGTH
□ UP TO 8'	24"
□ 9' TO 12'	36"

TABLE 3-B.3 FASTENER SCHEDULE

WIND SPEED (MPH)	NO. OF FASTENERS
□ 90 TO 105	4
□ 110 TO 130	6
□ 135 TO 150	8

NOTE: COLUMN POST MAY BE ADJUSTED ± 1 " FOR LEVELING. MANUFACTURER IS NOT RESPONSIBLE FOR LEVELING OF GROUND AND/OR CONCRETE SURFACE PROVIDED BY OTHERS.

TABLE 4: FRAME SPACING SCHEDULE

GROUND SNOW / ROOF LIVE LOAD (PSF)	■ ENCLOSED BUILDINGS							■ OPEN BUILDINGS						
	WIND SPEED (MPH)							WIND SPEED (MPH)						
	□ 90	□ 100	□ 110	□ 120	□ 130	□ 140	□ 150	□ 90	□ 100	□ 110	□ 120	□ 130	□ 140	□ 150
□ 30 / 20	60	60	54/60	54	42	42	36	48	48	48	42	36	30	24
□ 40 / 27	48/60	48/60	42/60	42/54	42	42	36	42	42	42	42	36	30	24
□ 50 / 34	40/48	40/48	40/48	40/48	40/42	40/42	36	30	30	30	30	30	30	24
□ 60 / 41	36	36	36	36	36	36	36	30	30	30	30	30	30	24
□ 70 / 47	30	30	30	30	30	30	30	24	24	24	24	24	24	24
□ 80 / 54	24	24	24	24	24	24	24	24	24	18	18	18	18	18
□ 90 / 61	---	---	---	---	---	---	---	---	---	---	---	---	---	---
□ 30 / 20	60	60	54/60	54	48	42/48	42	54	54	48/54	42/54	36/48	36	30
□ 40 / 27	48/60	48/60	42/60	42/54	42/48	42/48	42	42	42	42	42	36/42	36	30
□ 50 / 34	40/48	40/48	40/48	40/48	40/48	40/48	40/42	36	36	36	36	36	36	30
□ 60 / 41	36	36	36	36	36	36	36	30	30	30	30	30	30	30
□ 70 / 47	30	30	30	30	30	30	30	24	24	24	24	24	24	24
□ 80 / 54	24	24	24	24	24	24	24	24	24	24	24	24	24	24
□ 90 / 61	---	---	---	---	---	---	---	---	---	---	---	---	---	---
□ 30 / 20	60	60	54/60	54	48	42/48	42	60	54/60	48/60	42/54	36/48	36/42	36
□ 40 / 27	48/60	48/60	42/60	42/54	42/48	42/48	42	48	48	42/48	42/48	36/48	36/42	36
□ 50 / 34	40/48	40/48	40/48	40/48	40/48	40/48	40/42	40/42	40/42	40/42	40/42	36/42	36	36
□ 60 / 41	36	36	36	36	36	36	36	36	36	36	36	36	36	30
□ 70 / 47	30	30	30	30	30	30	30	30	30	30	30	30	30	30
□ 80 / 54	24	24	24	24	24	24	24	24	24	24	24	24	24	24
□ 90 / 61	---	---	---	---	---	---	---	---	---	---	---	---	---	---


EAVE HEIGHT = 10'-0" TO 12'-0"

EAVE HEIGHT = 7'-0" TO 9'-0"


EAVE HEIGHT = UP TO 6'-0"

NOTES:

1. FRAME SPACINGS ARE IN UNITS OF INCHES (IN).
2. WHERE TWO VALUES ARE SHOWN, THE HIGHER VALUE CAN ONLY BE USED FOR VERTICAL SHEATHING.
3. SNOW LOADS AND ROOF LIVE LOADS ARE IN POUNDS PER SQUARE FOOT (PSF). WIND SPEED IS 3 SEC. GUST IN MILES PER HOUR (MPH).
4. FOR VALUES THAT LIE BETWEEN TWO CELLS, THE HIGHER (MORE STRINGENT) VALUE HAS TO BE USED. INTERPOLATION BETWEEN CELLS IS NOT ALLOWED.




TYP. ENCLOSED BUILDING
SCALE: NTS



TYP. OPEN BUILDING
SCALE: NTS

GENERAL ENCLOSURE NOTES:

1. TYPICAL ENCLOSED AND OPEN BUILDINGS ARE AS SHOWN ON THE RIGHT.
2. THE MAX. BUILDING LENGTH FOR ENCLOSED BUILDINGS IS 50'-0". THIS CAN BE INCREASED BY ADDING A DOUBLE FRAME AT THE CENTER TO BREAK THE LENGTH OF THE BUILDING.
3. FOR ENCLOSED BUILDINGS, ONE END WALL CAN BE OPEN IF THE OTHER END WALL IS ENCLOSED. THE OPEN END WALL MUST HAVE EITHER GABLE FRAMING (SEE SHEET 8A) OR A DOUBLE END FRAME - SEE TYP. OPEN END WALL ON 3 SIDE ENCLOSED BUILDING. BUILDINGS WITH AN OPEN END WALL MUST HAVE A 10' PEAK BRACE ON ALL FRAMES.
4. OPEN BUILDINGS CAN HAVE PARTIALLY ENCLOSED SIDE WALLS UP TO 3' ENCLOSED.
5. ENCLOSED BUILDING WITH PARTIALLY ENCLOSED END WALLS NEED TO HAVE SIDE WALL BRACING TO SUPPORT THE PARTIALLY ENCLOSED END WALL. SEE SHEET 9 FOR TYPICAL BRACING DETAILS.

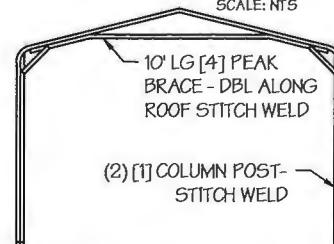

TYP. OPEN END WALL ON 3
SIDE ENCLOSED BUILDING
SCALE: NTS

TABLE 5.1: PURLIN SPACING SCHEDULE

GROUND SNOW / ROOF LIVE LOAD (PSF)	14GA. HAT CHANNEL PURLIN								18GA. HAT CHANNEL PURLIN							
	WIND SPEED (MPH)								WIND SPEED (MPH)							
	90	100	110	120	130	140	150	90	100	110	120	130	140	150		
30 / 20	54	48	42	36	30	24	24	36	30	24	18	18	12	12		
40 / 27	42	42	42	36	30	24	24	30	30	24	18	18	12	12		
50 / 34	40	40	40	36	30	24	24	24	24	24	18	18	12	12		
60 / 41	36	36	36	36	30	24	24	18	18	18	18	18	12	12		
70 / 47	32	32	32	32	30	24	24	18	18	18	18	18	12	12		
80 / 54	30	30	30	30	30	24	24	18	18	18	18	18	12	12		
90 / 61	24	24	24	24	24	24	24	12	12	12	12	12	12	12		
30 / 20	54	48	42	42	36	30	30	48	36	30	24	18	18	12		
40 / 27	42	42	42	42	36	30	30	42	36	30	24	18	18	12		
50 / 34	40	40	40	40	36	30	30	30	30	30	24	18	18	12		
60 / 41	36	36	36	36	36	30	30	30	30	30	24	18	18	12		
70 / 47	32	32	32	32	32	30	30	24	24	24	24	18	18	12		
80 / 54	32	32	32	32	32	30	30	18	18	18	18	18	18	12		
90 / 61	30	30	30	30	30	30	30	18	18	18	18	18	18	12		
30 / 20	54	48	42	42	36	36	30	54	48	36	30	24	24	18		
40 / 27	42	42	42	42	36	36	30	42	42	36	30	24	24	18		
50 / 34	40	40	40	40	36	36	30	40	40	36	30	24	24	18		
60 / 41	36	36	36	36	36	36	30	36	36	36	30	24	24	18		
70 / 47	32	32	32	32	32	32	30	30	30	30	30	24	24	18		
80 / 54	32	32	32	32	32	32	30	24	24	24	24	24	24	18		
90 / 61	30	30	30	30	30	30	30	24	24	24	24	24	24	18		
30 / 20	54	48	42	42	36	36	30	54	48	42	42	36	30	30		
40 / 27	42	42	42	42	36	36	30	42	42	42	42	36	30	30		
50 / 34	40	40	40	40	36	36	30	40	40	40	40	36	30	30		
60 / 41	36	36	36	36	36	36	30	36	36	36	36	36	30	30		
70 / 47	32	32	32	32	32	32	30	32	32	32	32	32	30	30		
80 / 54	32	32	32	32	32	32	30	32	32	32	32	32	30	30		
90 / 61	30	30	30	30	30	30	30	30	30	30	30	30	30	30		

NOTES:


1. PURLIN SPACING UNITS ARE IN INCHES.
2. FRAME SPACING NEEDS TO BE DETERMINED FROM TABLE 4.

TABLE 5.2: GIRT SPACING SCHEDULE

FRAME SPACING	WIND SPEED (MPH)						
	90	100	110	120	130	140	150
5'-0"	60	48	36	30	24	24	18
4'-6"	60	60	48	42	36	30	24
4'-0"	60	60	54	54	42	36	30
3'-6"	60	60	54	54	48	42	42
2'-0" TO 3'-0"	60	60	54	54	48	42	42


NOTES:

1. GIRT SPACING UNITS ARE IN INCHES.
2. THIS SCHEDULE IS TO BE USED FOR BOTH 14GA AND 18 GA PURLINS.
3. FRAME SPACING NEEDS TO BE DETERMINED FROM TABLE 4.

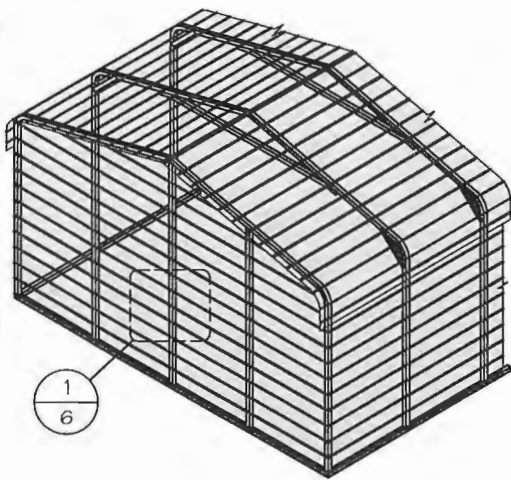

□ TYP. HORIZONTAL SHEATHING

SCALE: NTS

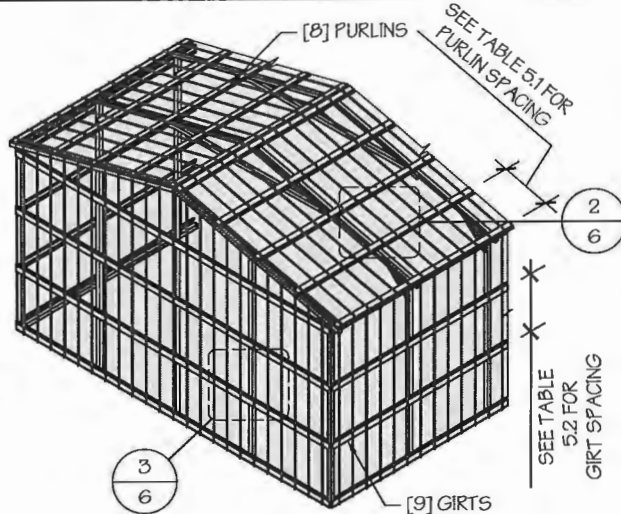


□ TYP. VERTICAL SHEATHING

SCALE: NTS


GENERAL SHEATHING NOTES:

1. REGULAR STYLE BUILDINGS CAN ONLY HAVE HORIZONTAL SHEATHING ON ROOF AND WALLS.
2. A-FRAME STYLE BUILDINGS CAN HAVE ANY COMBINATION OF HORIZONTAL OR VERTICAL SHEATHING ON ROOFS AND WALLS.
3. BOTH HORIZONTAL AND VERTICALS ROOF SHEATHING CAN HAVE MAX. 6" OVERHANG.
4. USING VERTICAL SHEATHING MAY ALLOW FOR GREATER FRAME SPACING. SEE NOTE 2 UNDER TABLE 4.

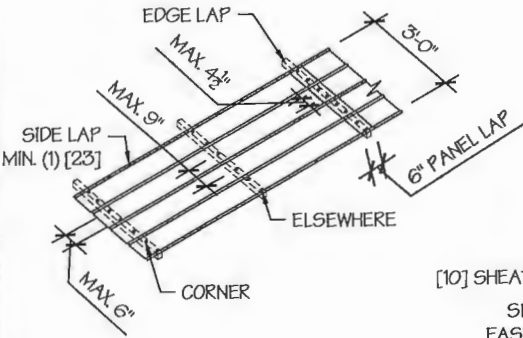

TYP. SHEATHING FASTENER SCHEDULE


SCALE: NTS

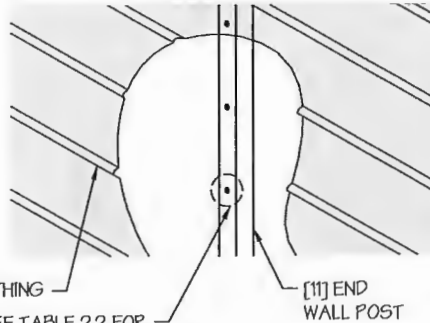

SEE TABLE 2.2 FOR FASTENER SCHEDULE


TYP. HORIZONTAL SHEATHING DETAIL 1

SCALE: NTS

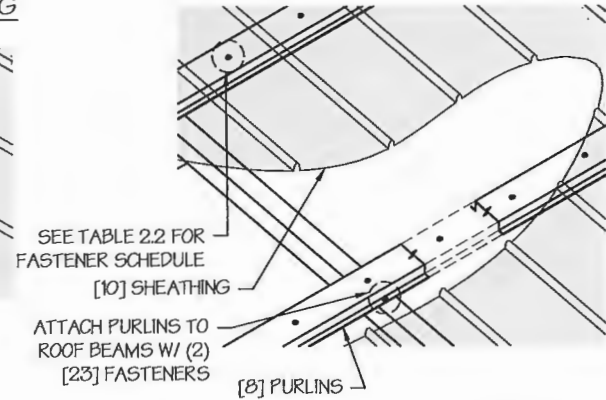


ROOF VERTICAL SHEATHING DETAIL 2

SCALE: NTS

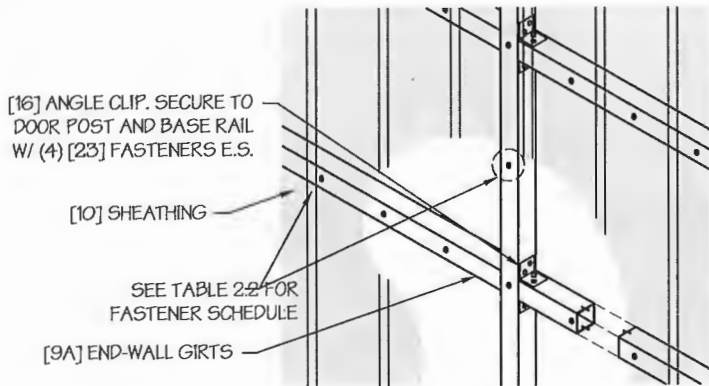


□ WALL VERTICAL SHEATHING - TUBE DETAIL 3

SCALE: NTS

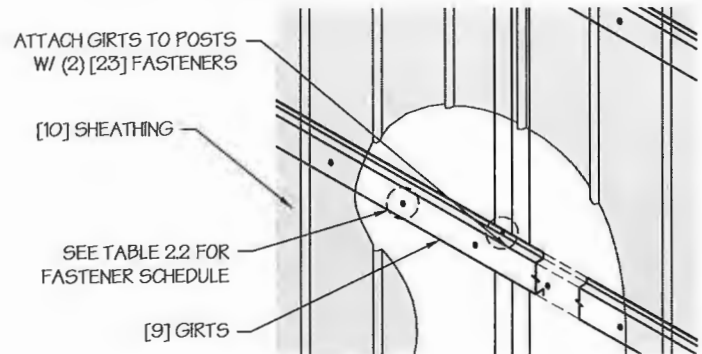


□ WALL VERTICAL SHEATHING - HAT CHANNEL DETAIL 3

SCALE: NTS

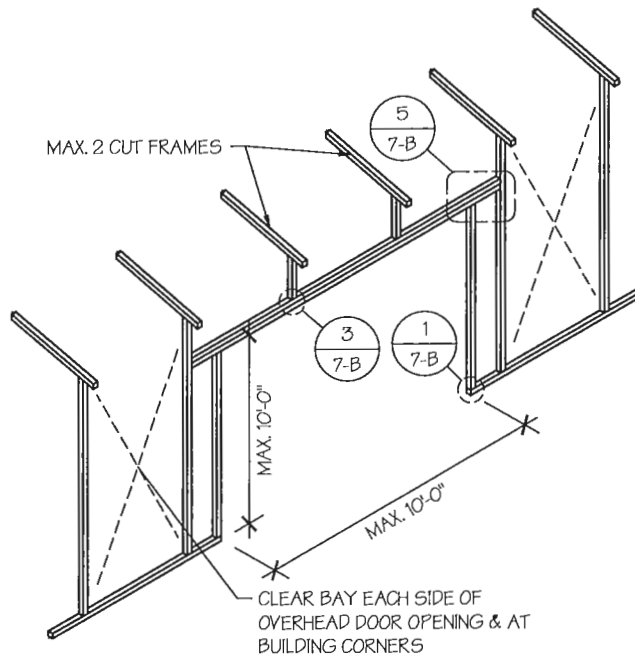


SIDE WALL OVERHEAD DOOR OPENINGS

SCALE: NTS

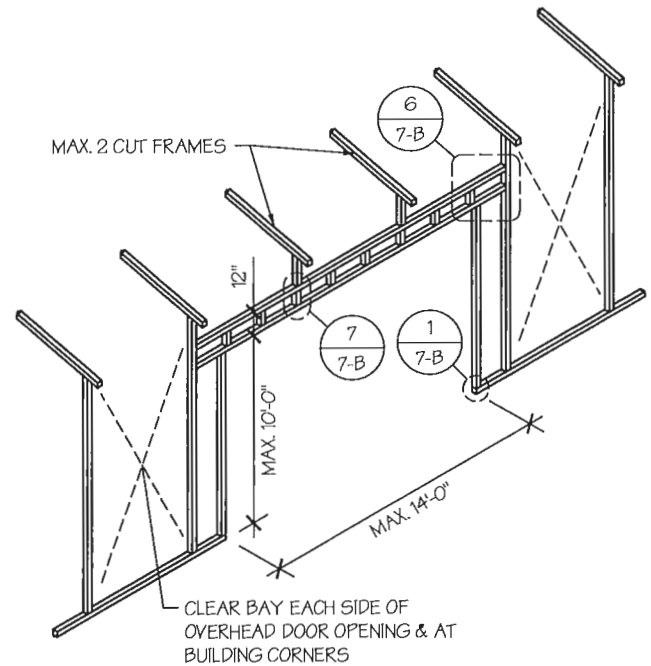

SIDE WALL OVERHEAD DOOR OPENINGS WITH TRUSS STYLE HEADER

SCALE: NTS







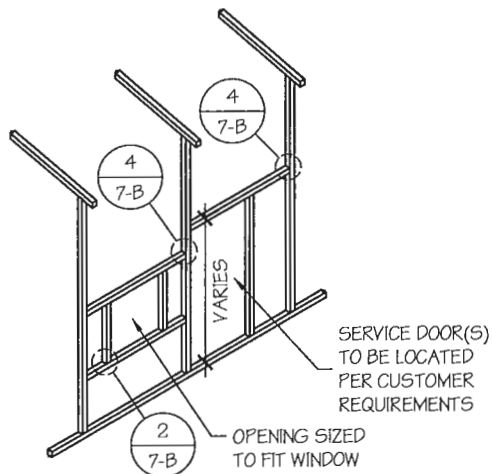



SIDE WALL SERVICE DOOR / WINDOW OPENINGS

SCALE: NTS


SIDE WALL FRAMING NOTES:

1. TRUSS-STYLE HEADERS ARE REQUIRED FOR WHERE THE GROUND SNOW LOAD IS 40 PSF OR GREATER.
2. DESIGNS AND DETAILS SHOWN HERE ARE APPLICABLE TO BOTH REGULAR AND A-FRAME STYLE BUILDINGS.
3. MAX. HEIGHT OF SIDE WALL OVERHEAD DOOR OPENINGS IS 2 FT LESS THAN THE EAVE HEIGHT.
4. OVERHEAD DOOR OPENINGS CANNOT CUT THROUGH MORE THAN 2 FULL FRAMES.
5. MIN. 1 CLEAR BAY MUST BE MAINTAINED BETWEEN ANY 2 OVERHEAD DOOR OPENINGS. A CLEAR BAY IS A SPACE BETWEEN TWO FRAMES THAT HAS NO OVERHEAD DOOR OPENINGS.
6. MIN. 1 CLEAR BAY MUST ALSO BE MAINTAINED FROM THE BUILDING CORNERS.
7. SERVICE DOORS AND WINDOWS CAN BE PLACED IN CLEAR BAYS OR ANY WHERE ELSE AS NEEDED.

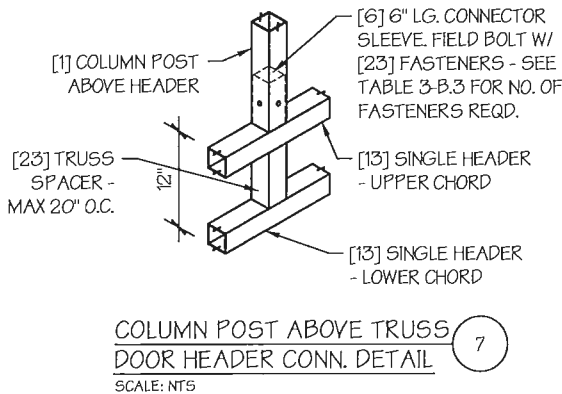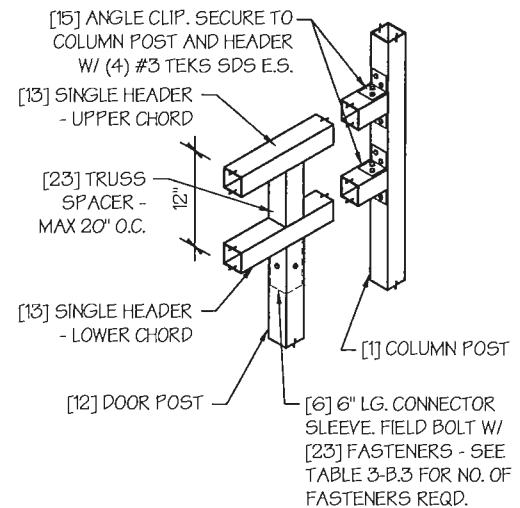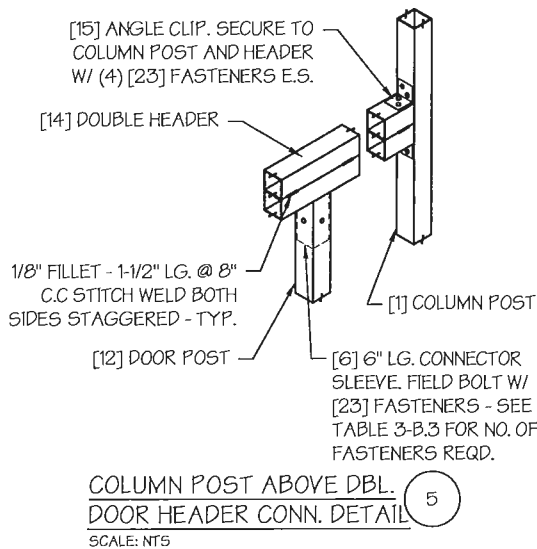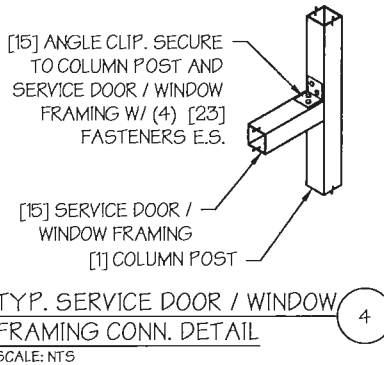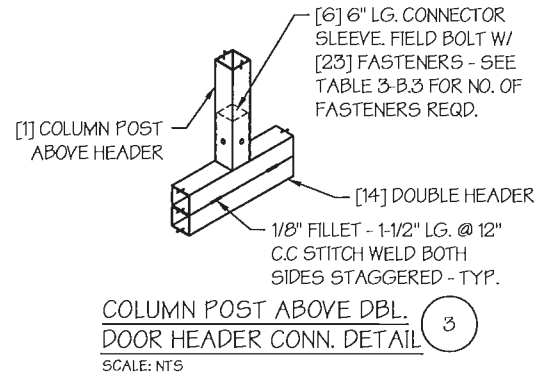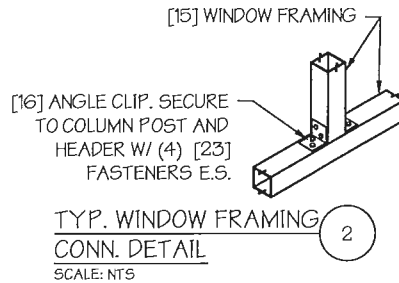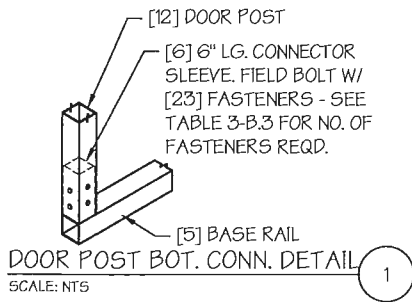


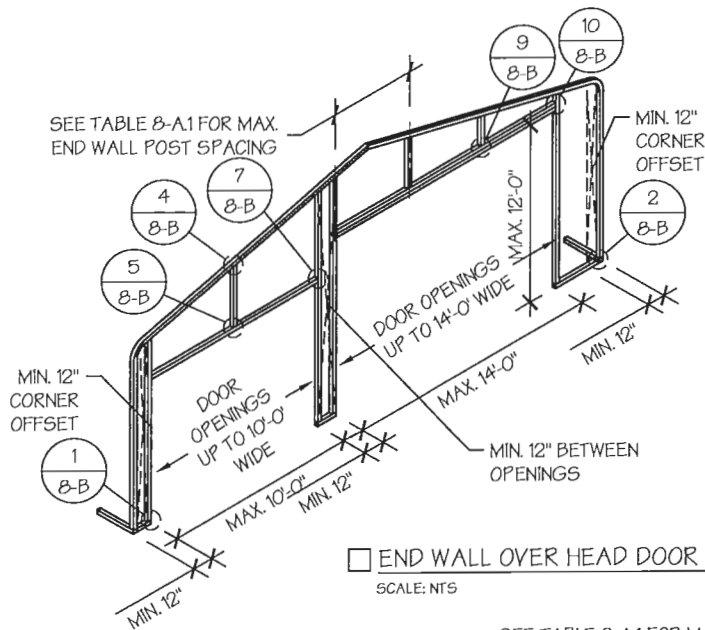


□ END WALL OVER HEAD DOOR OPENINGS
SCALE: NTS

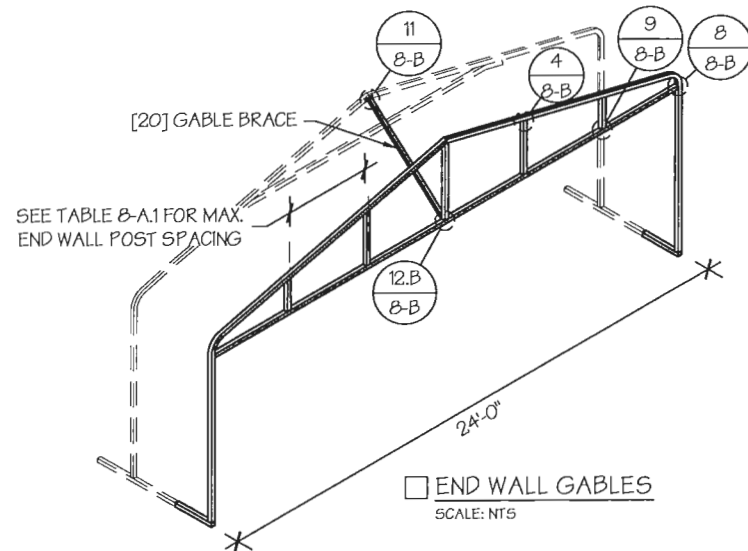

□ END WALL GABLES
SCALE: NTS

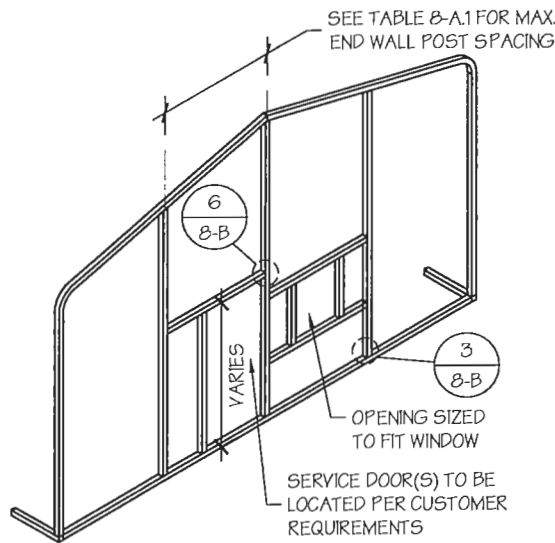

□ END WALL SERVICE DOOR AND WINDOW OPENINGS
SCALE: NTS

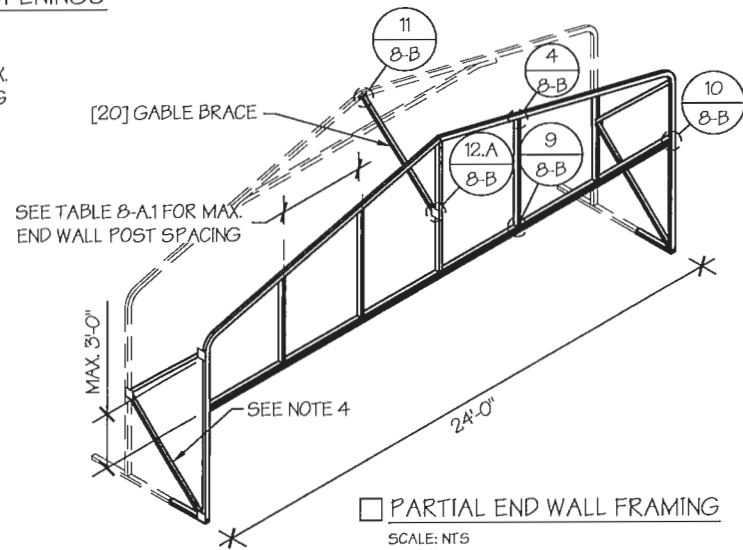


□ PARTIAL END WALL FRAMING
SCALE: NTS

TABLE 8-A.1: END WALL POST SPACING SCHEDULE

WIND SPEED (MPH)	EAVE HEIGHT		
	■ UP TO 7'	■ 8' TO 9'	■ 10' TO 12'
□ 90	5'	5'	5'
□ 100	5'	5'	4.5'
□ 110	4.5'	4.5'	4'
□ 120	4.5'	4.5'	3'
□ 130	4'	4'	2.5'
□ 140 - 150	3.5'	3'	2'


END WALL FRAMING NOTES:

- DESIGNS AND DETAILS SHOWN HERE ARE APPLICABLE TO BOTH REGULAR AND A-FRAME STYLE BUILDINGS.
- MIN. 12" CLEARANCE MUST BE MAINTAINED BETWEEN ANY TWO OPENINGS (OVERHEAD DOOR OR SERVICE DOOR) AND FROM CORNERS.
- SERVICE DOORS AND WINDOWS CAN BE PLACED AS NEEDED.
- DIAGONAL BRACES NEED TO BE ADDED FOR PARTIAL END WALL ENCLOSURES. SEE SHEET 9 FOR DIAGONAL BRACE CONNECTION DETAILS.

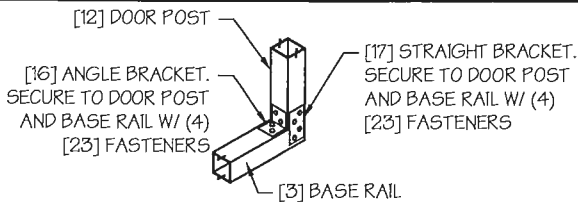


DOOR POST BASE RAIL CONN. DETAIL

SCALE: NTS

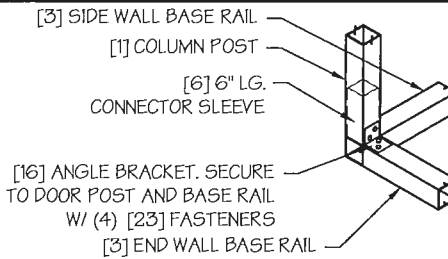


CORNER DETAIL

SCALE: NTS

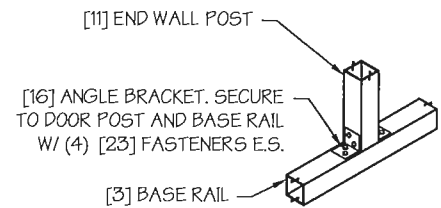


END WALL POST - BASE RAIL CONN. DETAIL

SCALE: NTS

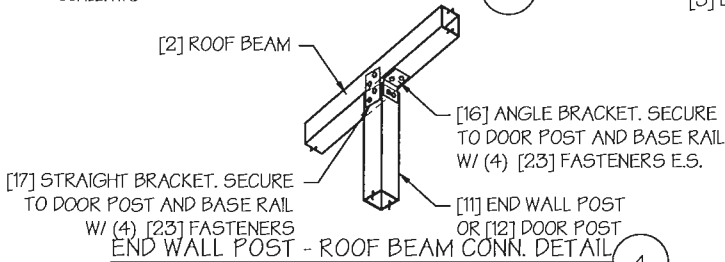


END WALL POST - ROOF BEAM CONN. DETAIL

SCALE: NTS

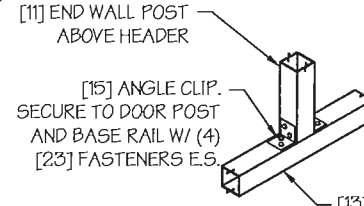


END WALL POST ABOVE HEADER CONN. DETAIL

SCALE: NTS

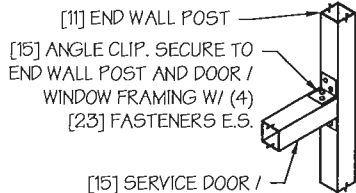


TYP. SERVICE DOOR / WINDOW FRAMING CONN. DETAIL

SCALE: NTS

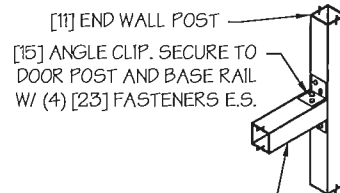


HEADER - END WALL POST CONN. DETAIL

SCALE: NTS




GABLE HEADER - CORNER POST CONN. DETAIL

SCALE: NTS

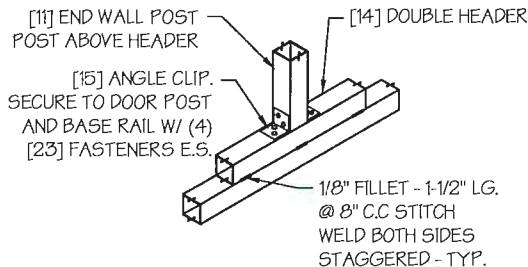


END WALL POST ABOVE DOUBLE HEADER CONN. DETAIL

SCALE: NTS

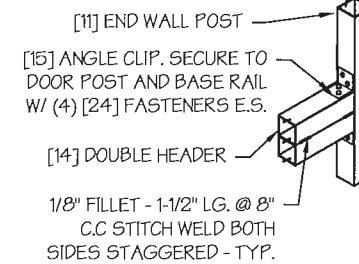


DOUBLE HEADER - END WALL POST CONN. DETAIL

SCALE: NTS

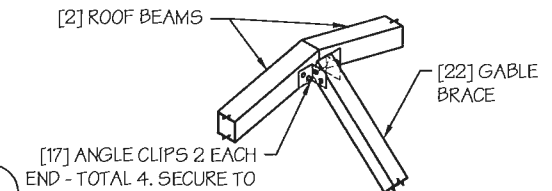


TYP. GABLE BRACE CONN. DETAIL

SCALE: NTS

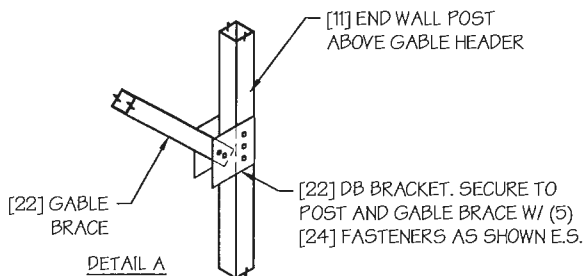


GABLE BRACE - END WALL CONN. DETAIL


SCALE: NTS

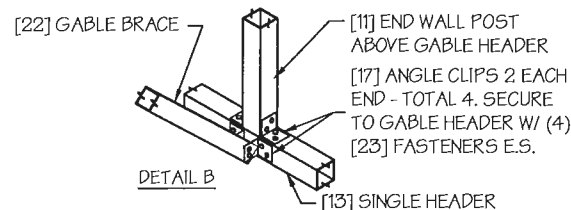


DETAIL B

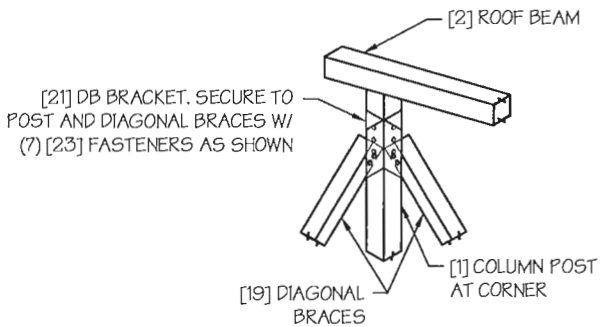

DIAGONAL BRACE TOP CORNER CONN. DETAIL* 1
SCALE: NTS

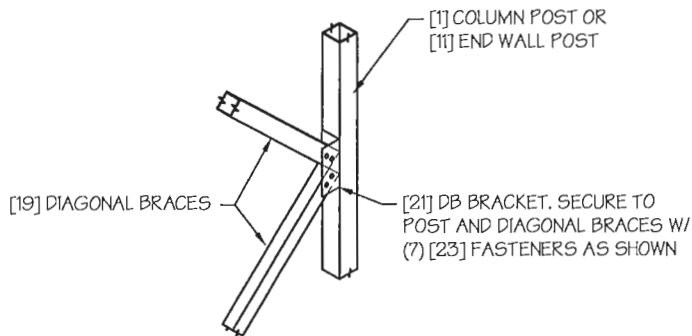


DIAGONAL BRACE - POST CONN. DETAIL* 2
SCALE: NTS

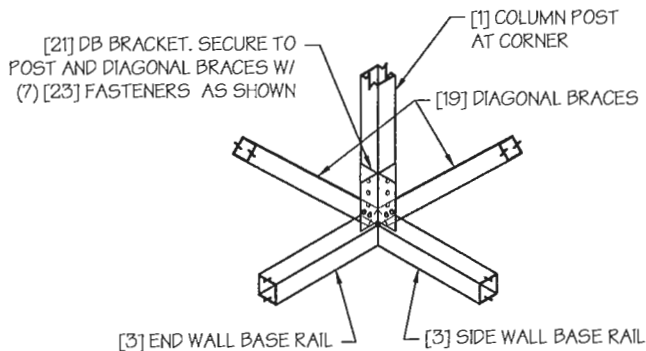

DIAGONAL BRACE BOT. CORNER CONN. DETAIL* 3
SCALE: NTS


* INSIDE VIEW SHOWN FOR CLARITY

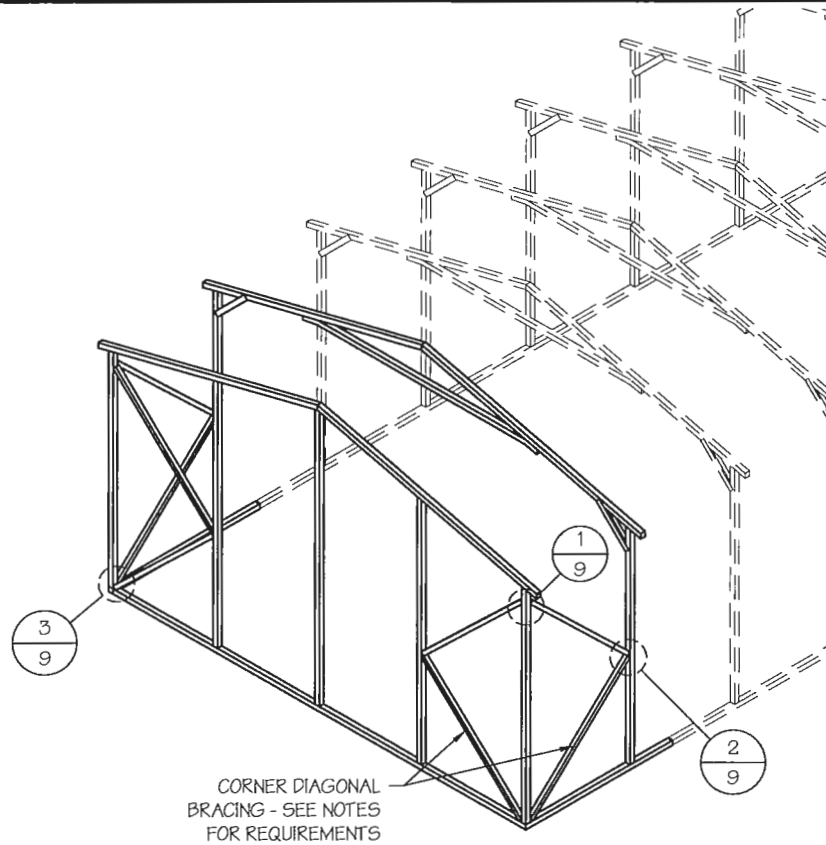

DIAGONAL BRACING AT CORNERS
SCALE: NTS


CORNER BRACING NOTES:

1. DIAGONAL BRACING AT BUILDING CORNERS IS REQUIRED FOR FULLY ENCLOSED BUILDINGS IN LOCATIONS WHERE WIND SPEED IS 120 MPH OR GREATER.
2. IF CORNER BRACING IS REQUIRED BUT THE BUILDING IS MISSING ONE OR BOTH END WALLS THEN THE BUILDING MUST BE DESIGNED AS AN OPEN BUILDING AND SIDE WALL DIAGONAL BRACING IS REQUIRED (USE SPACING FOR OPEN BUILDING IN TABLE 4.1).
3. DIAGONAL BRACING IS ALSO REQUIRED ON THE CORNERS ON THE SIDE WALLS WHEN THE ADJACENT END WALL IS PARTIALLY ENCLOSED.

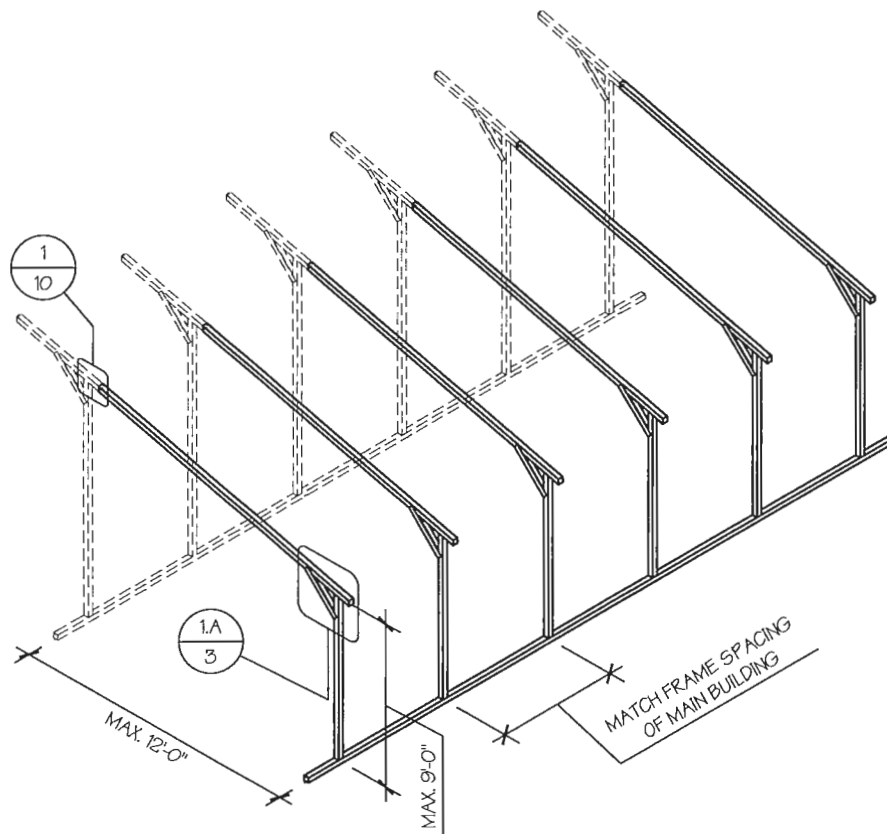

□ OPTIONAL LEAN-TO ADDITION

SCALE: NTS

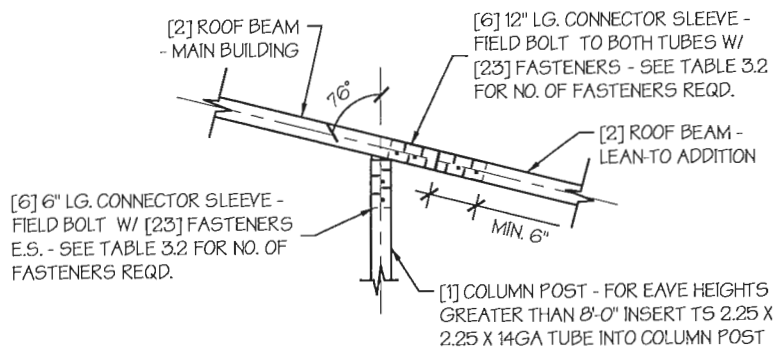

LEAN-TO ATTACHMENT DETAIL

SCALE: NTS



1

LEAN-TO ADDITION NOTES:

1. LEAN-TO ADDITIONS CAN BE ADDED ON EITHER OR BOTH SIDES OF THE BUILDING.
2. ROOF SLOPE AND PURLIN, GIRT AND FRAME SPACINGS OF THE ADDITION HAVE TO MATCH THAT OF THE MAIN STRUCTURE..
3. IF THE LEAN-TO ADDITION IS "OPEN "(BOTH END WALLS OR SIDE WALL IS NOT ENCLOSED), THE DESIGN OF THE MAIN BUILDING HAS TO USE THE FRAME SPACING OF AN OPEN BUILDING FROM TABLE 4.

CONCRETE SLAB FOUNDATION NOTES:

- DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE SLAB FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU D CAN BE USED.
- CONCRETE ANCHORS SHALL BE LOCATED NEXT TO EVERY POST AND ON EITHER SIDE OF OPENINGS. TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST.
- ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING.
- MIN. NUMBER OF CONCRETE ANCHORS PER POST SHALL BE AS SHOWN IN TABLE 11-A.2.
- THE SIZE OF THE SLAB SHALL BE THE SIZE (WIDTH AND LENGTH) OF THE BUILDING PLUS $5\frac{1}{2}$ " FOR 14GA MATERIAL AND $5\frac{3}{4}$ " FOR 12GA MATERIAL.
- DEPTH OF SLAB TURN DOWN FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
- CONTROL JOINTS SHALL BE PLACED SO AS TO LIMIT MAX. SLAB SPANS TO 20' IN EACH DIRECTION.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.
- CONCRETE STRENGTH TO BE A MIN. OF 2500 PSI @ 28 DAYS.

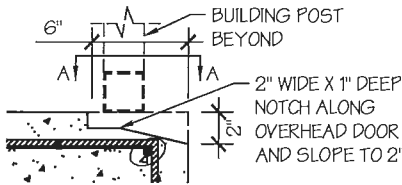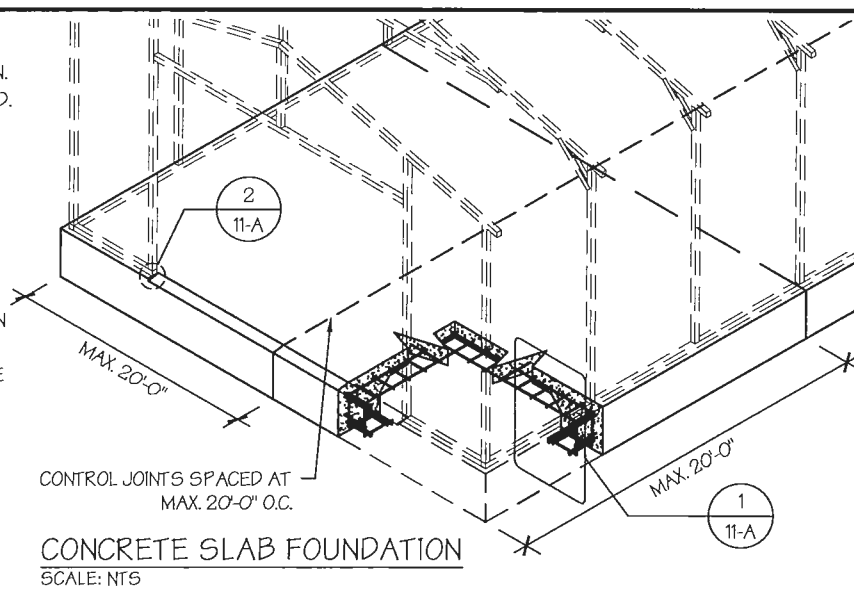

OVERHEAD DOOR NOTCH DETAIL

SCALE: NTS

2

TABLE 11-A.2: CONCRETE SLAB ANCHOR SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	□ 90 TO 110	(1) 1/2"Ø X 7"
	□ 120 TO 150	(2) 1/2"Ø X 7"
OPEN	□ 90 TO 100	(1) 1/2"Ø X 7"
	□ 110 TO 150	(2) 1/2"Ø X 7"

NOTES:

- ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS THAT HAVE AN ALLOWABLE UPLIFT CAPACITY OF 1200 LBS AND SHEAR CAPACITY OF 900 LBS.
- MIN. EMBEDMENT DEPTH TO BE $2\frac{3}{4}$ ".
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS.




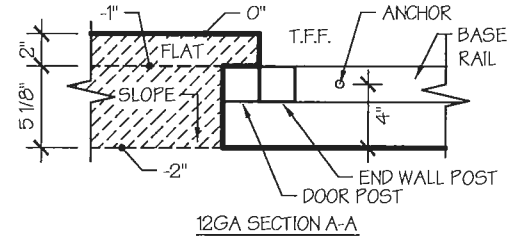


TABLE 11-A.1: NOTCH WIDTH

HORIZONTAL/OPEN		VERTICAL	
□ 14GA	□ 12GA	□ 14GA	□ 12GA
2 3/4"	2 7/8"	1 3/4"	1 7/8"


NOTE: DEPTH IS TO BE 1 1/2"

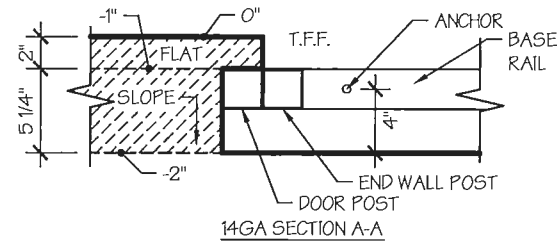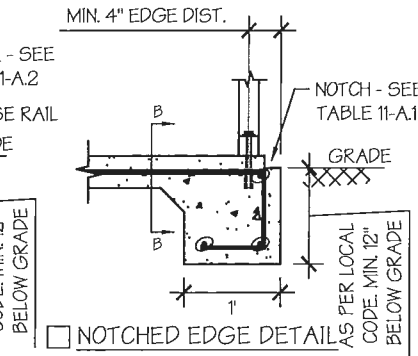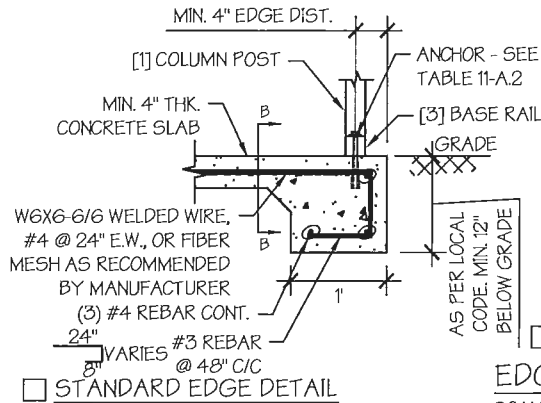

EDGE OFFSET DETAIL

SCALE: NTS

1

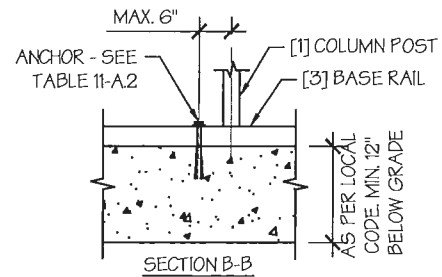

CONCRETE SLAB FOUNDATION NOTES:

- DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE SLAB FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU D CAN BE USED.
- CONCRETE ANCHORS SHALL BE LOCATED NEXT TO EVERY POST AND ON EITHER SIDE OF OPENINGS. TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST.
- ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING.
- MIN. NUMBER OF CONCRETE ANCHORS PER POST SHALL BE AS SHOWN IN TABLE 11-A.1.
- THE SIZE OF THE SLAB SHALL BE THE SIZE (WIDTH AND LENGTH) OF THE BUILDING PLUS $\frac{1}{2}$ " FOR 14GA MATERIAL AND 1" FOR 12GA MATERIAL.
- DEPTH OF SLAB TURN DOWN FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
- CONTROL JOINTS SHALL BE PLACED SO AS TO LIMIT MAX. SLAB SPANS TO 20' IN EACH DIRECTION.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.
- CONCRETE STRENGTH TO BE A MIN OF 2500 PSI @ 28 DAYS.


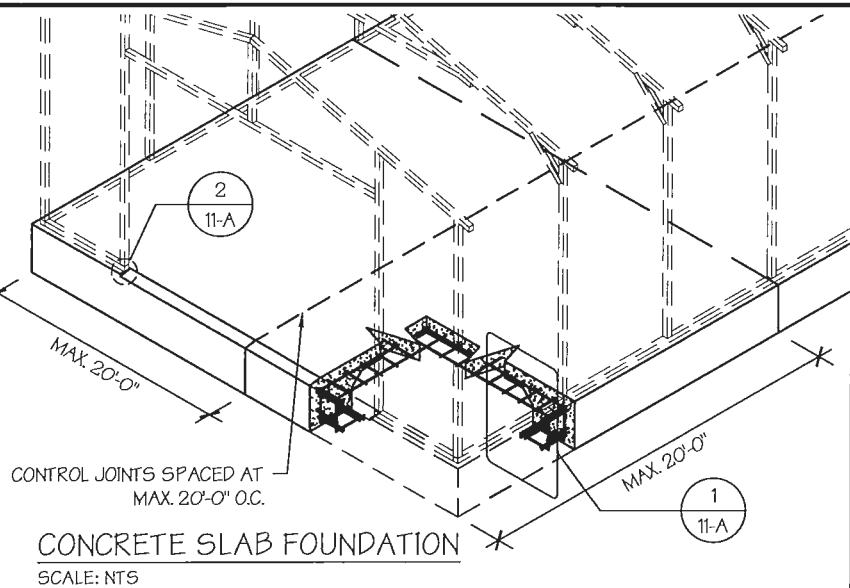


TABLE 11-A.1: CONCRETE SLAB ANCHOR SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	□ 90 TO 110	(1) 1/2" Ø X 7"
	□ 120 TO 150	(2) 1/2" Ø X 7"
OPEN	□ 90 TO 100	(1) 1/2" Ø X 7"
	□ 110 TO 150	(2) 1/2" Ø X 7"

NOTES:



- ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS THAT HAVE AN ALLOWABLE UPLIFT CAPACITY OF 1200 LBS AND SHEAR CAPACITY OF 900 LBS.
- MIN. EMBEDMENT DEPTH TO BE $2\frac{1}{8}$ ".
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS.

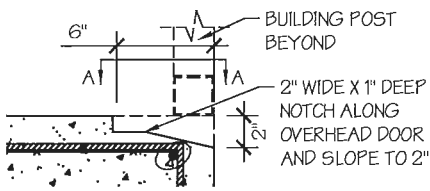

OVERHEAD DOOR NOTCH DETAIL


SCALE: NTS

2

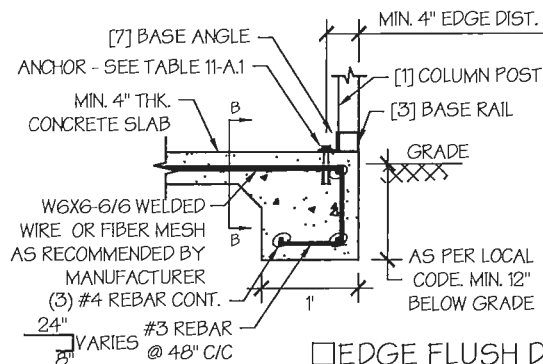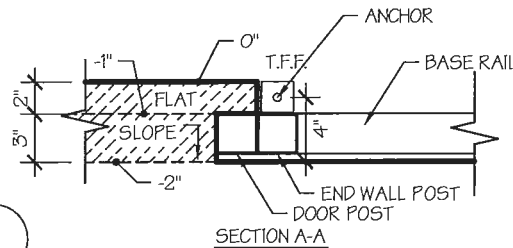

EDGE FLUSH DETAIL

SCALE: NTS

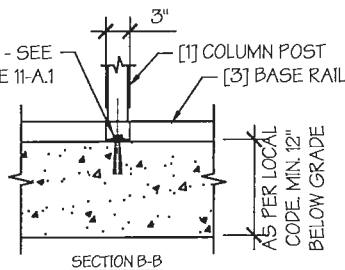

1

TABLE 11-B.1: ANCHOR SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	□ 90 TO 110	(1) 1/2"Ø X 7"
	□ 120 TO 150	(2) 1/2"Ø X 7"
OPEN	□ 90 TO 100	(1) 1/2"Ø X 7"
	□ 110 TO 150	(2) 1/2"Ø X 7"

NOTES:

1. ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS THAT HAVE AN ALLOWABLE UPLIFT CAPACITY OF 1200 LBS AND SHEAR CAPACITY OF 900 LBS.
2. MIN. EMBEDMENT DEPTH TO BE 2 2/3".
3. ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS.


TABLE 11-B.2: CONC. STRIP SCHEDULE

WIND SPEED (MPH)	MIN. SIZE REQD.
□ 90 TO 110	14" X 12"
□ 120 TO 130	21" X 12"
□ 140 TO 150	30" X 12"
	24 X 15"
	20" X 18"

NOTES:

1. WIDTH AND DEPTH DIMENSIONS CAN BE INTERCHANGED.

FOOTING OPTIONAL AT OPEN END WALLS AND OVERHEAD DOOR OPENINGS

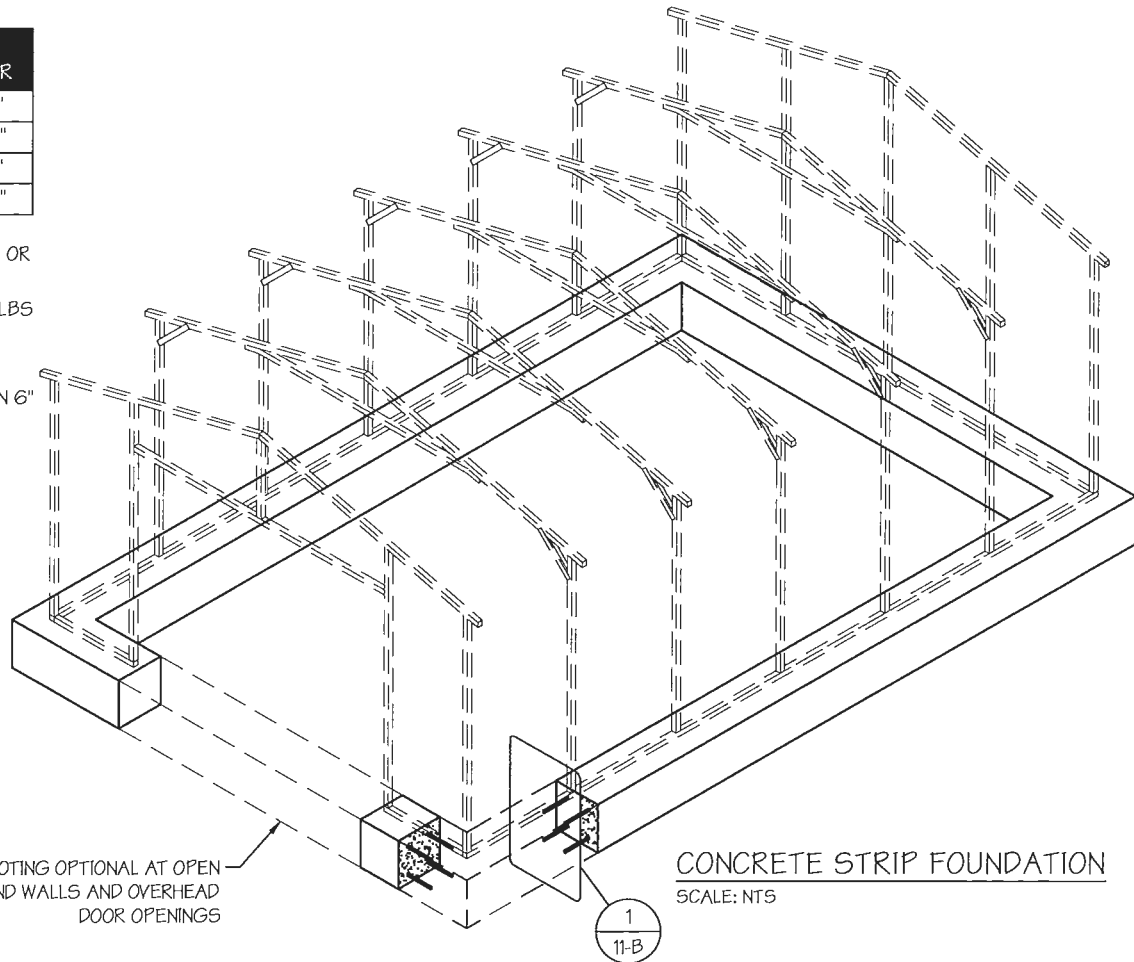


CONCRETE STRIP FOUNDATION

SCALE: NTS


CONCRETE STRIP FOUNDATION NOTES:

1. DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE STRIP FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU D CAN BE USED.
2. CONCRETE ANCHORS SHALL BE LOCATED NEXT TO EVERY POST AND ON EITHER SIDE OF OPENINGS. TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST.
3. MIN. NUMBER OF CONCRETE ANCHORS PER POST SHALL BE AS SHOWN IN TABLE 11-B.1.
4. ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING.
5. DEPTH OF CONCRETE STRIP FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
6. ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.
7. CONCRETE STRENGTH TO BE A MIN OF 2500 PSI @ 28 DAYS.
8. BUILDING IS TO BE MOUNTED ON THE CENTER OF THE STRIP FOUNDATION.

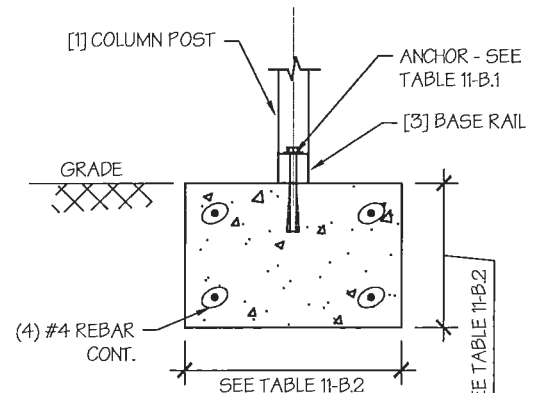


CONCRETE STRIP FOUNDATION DETAIL

SCALE: NTS

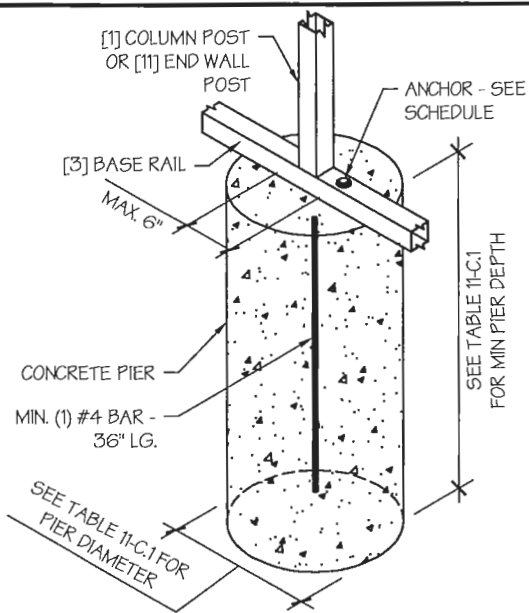


CONCRETE PIER DETAIL
SCALE: NTS

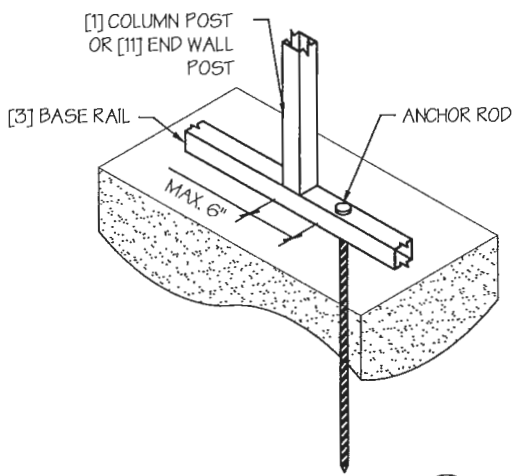

ANCHOR ROD INTO SOIL DETAIL
SCALE: NTS

TABLE 11-C.1: CONC. PIER SCHEDULE

WIND SPEED (MPH)	MIN. SIZE REQD.
□ 90 TO 110	24"Ø X 36"
□ 120 TO 130	24"Ø X 42"
□ 140 TO 150	24"Ø X 48"

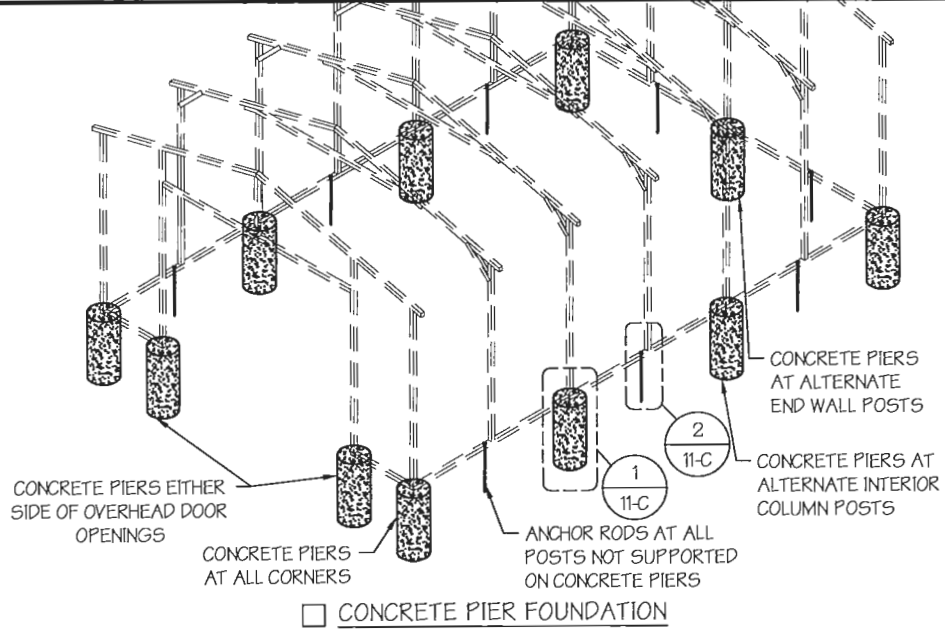

CONCRETE PIER FOUNDATION NOTES:


- DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE PIER FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU D CAN BE USED.
- CONCRETE PIERS SHALL BE LOCATED AT ALL 4 CORNERS, ON EACH SIDE OF OVERHEAD DOOR OPENINGS AND ON ALTERNATE INTERIOR COLUMN POSTS AND END WALLS POSTS.
- TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST WITH A PIER.
- ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING.
- MIN. NUMBER OF CONCRETE ANCHORS PER POST WITH A PIER SHALL BE AS SHOWN IN TABLE 11-C.2.
- TWO ANCHORS AND A PIER ARE REQUIRED AT DIAGONAL BRACING LOCATIONS WHEN REQUIRED.
- ALL POSTS NOT SUPPORTED ON CONCRETE PIERS SHALL BE ANCHORED TO THE GROUND WITH A 1/2" X 30" LG. THREADED ROD. RODS WILL HAVE A PRE-FORMED HEAD AT THE TOP AND ONE COAT OF RUST PROOF MATERIAL.
- PIERS SHALL BE FORMED BY DIGGING A HOLE OF THE SAME SIZE AS THE PIER ON LEVEL GRADE AND FILLING IT WITH CONCRETE. THRD. ROD ANCHORS SHOULD BE DROPPED INTO THE PIERS PRIOR TO POURING THE CONCRETE.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.
- CONCRETE STRENGTH TO BE A MIN OF 2500 PSI @ 28 DAYS.

TABLE 11-C.2: ANCHOR SCHEDULE


ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	□ 90 TO 110	(1) 1/2"Ø X 7"
	□ 120 TO 150	(2) 1/2"Ø X 7"
OPEN	□ 90 TO 100	(1) 1/2"Ø X 7"
	□ 110 TO 150	(2) 1/2"Ø X 7"

NOTES:

- ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS THAT HAVE AN ALLOWABLE UPLIFT CAPACITY OF 1200 LBS AND SHEAR CAPACITY OF 900 LBS.
- MIN. EMBEDMENT DEPTH TO BE 2 7/8".
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS.

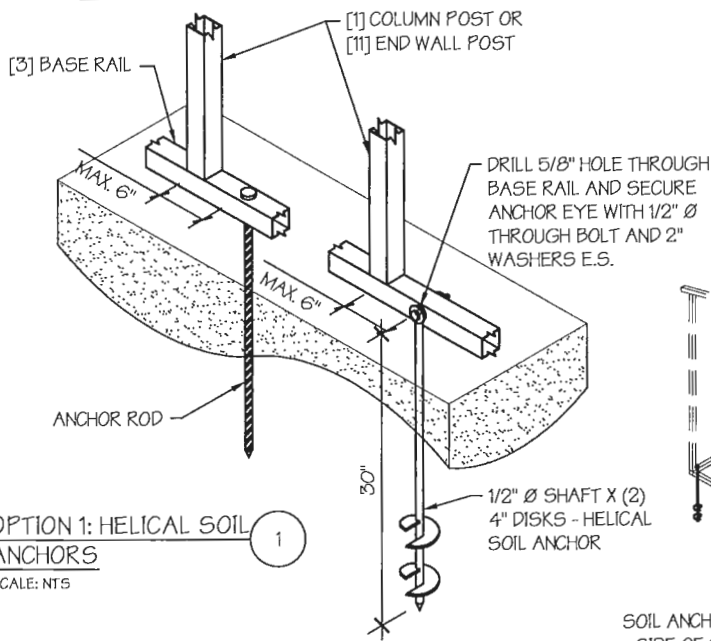

OPTION 1: HELICAL SOIL ANCHORS
SCALE: NTS

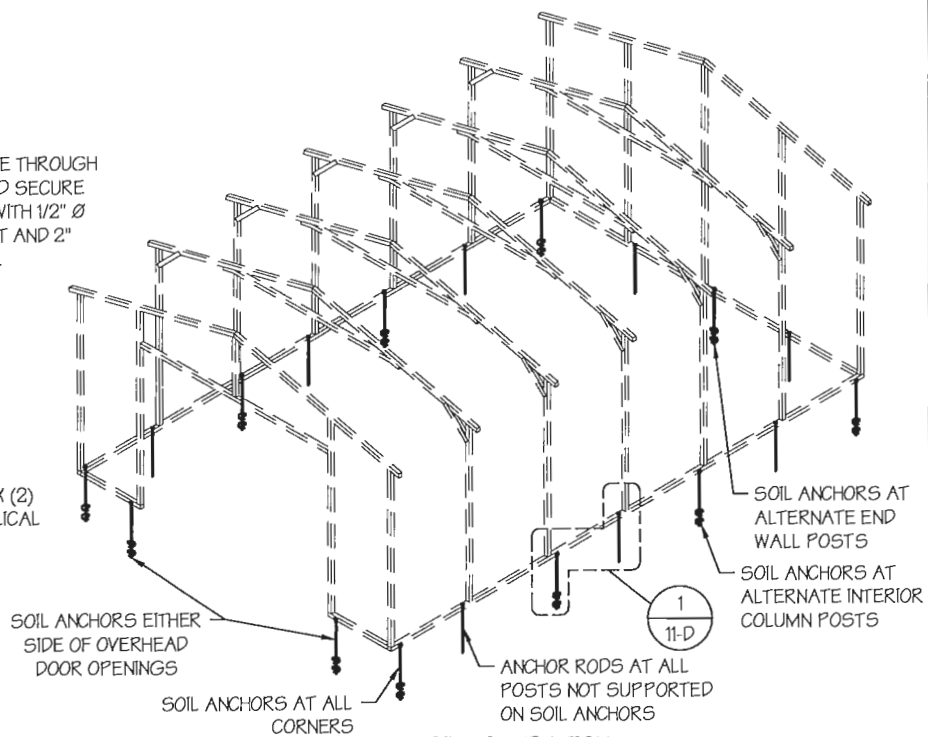

SOIL FOUNDATION
SCALE: NTS


SOIL FOUNDATION NOTES:

- DESIGNS SHOWN ON THIS SHEET ARE FOR SOIL ANCHOR FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU D CAN BE USED.
- SOIL ANCHORS (HELICAL OR ROCK/ASPHALT) SHALL BE LOCATED AT ALL 4 CORNERS, ON EACH SIDE OF OVERHEAD DOOR OPENINGS, ON POSTS WITH DIAGONAL BRACING IF REQUIRED, AND ON ALTERNATE INTERIOR COLUMN POSTS AND END WALLS POSTS.
- HELICAL ANCHORS ARE TO BE USED ONLY IF THE DRIVING TORQUE INTO THE GROUND IS 150 FT-LBS OR GREATER. MANUFACTURER IS NOT RESPONSIBLE FOR SOIL QUALITY AT SITE.
- HELICAL ANCHORS CAN ONLY BE USED FOR CLASS 2, 3 & 4 SOILS (SEE SOIL CLASSIFICATIONS THIS PAGE).
- ALL POSTS WITH NO ANCHORS ADJACENT SHALL BE ANCHORED TO THE GROUND WITH A 1/2" X 30" LG. ROD. RODS WILL HAVE A PRE-FORMED HEAD AT THE TOP AND ONE COAT OF RUST PROOF MATERIAL.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.

SOIL CLASSIFICATIONS:

SOIL CLASS	DESCRIPTION
2	SANDY GRAVEL AND GRAVEL, VERY THIN DENSE AND/OR CEMENTED SANDS, COARSE GRAVEL/COBBLES, PRELOADED SILTS, CLAYS AND CORAL.
3	SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL, MEDIUM DENSE COARSE SANDS, SANDY GRAVEL, VERY STIFF SILT AND SANDY CLAYS.
4	LOOSE TO MEDIUM DENSE SANDS, FIRM TO STIFF CLAYS AND SILTS AND ALLUVIAL FILLS.

*FROM HUD "MODEL MANUFACTURED HOME INSTALLATION STANDARDS"

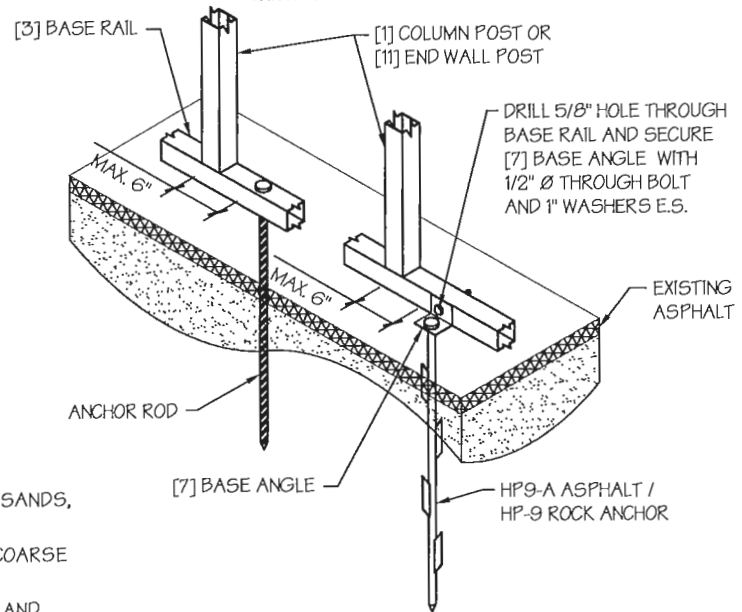

OPTION 2: ROCK / ASPHALT ANCHORS
SCALE: NTS